


GENERAL NOTES:

- 1 1/2" HOT AND COLD WATER, 1 1/2" WASTE DOWN, 1 1/2" VENT UP.
- 2 1" HOT AND 2 1/2" COLD WATER DOWN.
- 3 4" WASTE DOWN, 4" VENT UP, 4" VENT THRU ROOF.
- 4 1" HOT AND COLD WATER DOWN.
- 5 3" VENT FROM BELOW.
- 6 REFER TO DRAWING P301 FOR ENLARGED PLAN.
- 7 2" WASTE DOWN, 1 1/2" VENT UP.
- 8 6" FROM OVERFLOW ROOF DRAIN ABOVE.
- 9 6" FROM ROOF DRAIN ABOVE.
- 10 6" ROOF CONDUCTOR.
- 11 4" WASTE DOWN, 3" VENT UP.
- 12 2 1/2" COLD WATER DOWN.
- 13 3/4" COLD WATER FROM BELOW.
- 14 ROUTE PIPING BELOW CONCRETE SEATING.
- 15 3/4" COLD WATER DOWN.
- 16 1/2" HOT AND COLD WATER, 1 1/2" WASTE DOWN, 1 1/2" VENT UP, 3" VENT THRU ROOF.
- 17 CONNECT 1 1/4" CONDENSATE DRAIN PIPING TO FAN COIL UNIT.
- 18 TERMINATE 1 1/4" CONDENSATE DRAIN PIPING OVER OPEN SITE DRAIN (020-1).
- 19 3/4" HOT AND COLD WATER DOWN, 2" VENT FROM BELOW.
- 20 2" VENT UP, 3" VENT THRU ROOF.
- 21 TERMINATE 1 1/4" CONDENSATE DRAIN PIPING OVER MOP SERVICE BASIN (P-7).
- 22 1/2" COLD WATER DOWN.
- 23 FLUSH MOUNTED CO₂ FILL BOX.
- 24 2" VENT FROM BELOW.
- 25 3/4" HOT AND COLD WATER FROM BELOW, ROUTE PIPING IN DIVING TOWER COLUMN.
- 26 4" SURGE/BALANCE TANK VENT FROM BELOW, TERMINATE VENT PIPING THRU AIR INLET FITTING, SIMILAR TO ZURN #ZANB-1472.
- 27 CONNECT 1 1/2" GAS PIPING TO GAS FIRED EMERGENCY GENSET GAS TRAIN ASSEMBLY.
- 28 GAS METER/ SERVICE ASSEMBLY, SERVICE SIZED FOR 10000 MSH AT 2 PSIG INCOMING SERVICE, GAS SERVICE/ METER ASSEMBLY BY UTILITY COMPANY.
- 29 CONNECT 6" GAS PIPING TO GAS METER, PRESSURE REDUCING VALVE SIZED FOR 10000 MSH WITH AN INLET PRESSURE OF 2 PSIG AND AN OUTLET PRESSURE OF 10" WC.
- 30 6" GAS SERVICE, SEAL PENETRATION THRU WALL WEATHER TIGHT, MAIN SHUT OFF VALVE INSTALLED AT 24" AFF.
- 31 4" FROM OVERFLOW ROOF DRAIN ABOVE.
- 32 4" FROM ROOF DRAIN ABOVE.
- 33 6" ROOF CONDUCTOR FROM ABOVE.
- 34 8" ROOF CONDUCTOR FROM DOWN.
- 35 3" VENT FROM BELOW, 3" VENT UP, 3" VENT THRU ROOF.
- 36 1 1/4" CONDENSATE DRAIN PIPING DOWN, TERMINATE OVER OPEN SITE DRAIN.
- 37 FIRE MAIN SHUT OFF VALVE IN ROADWAY BOX.
- 38 DOMESTIC WATER MAIN SHUT OFF VALVE IN ROADWAY BOX.
- 39 4" ROOF CONDUCTOR.

PLAN NOTES:

- 1 24" x 48" MAIN DRAIN
- 2 24" x 48" MAIN DRAIN
- 3 24" x 48" MAIN DRAIN
- 4 24" x 48" MAIN DRAIN
- 5 24" x 48" MAIN DRAIN
- 6 24" x 48" MAIN DRAIN
- 7 SPARGER PLENUM
- 8 SPARGER PLENUM
- 9 SPARGER PLENUM
- 10 SPARGER PLENUM
- 11 SPARGER PLENUM
- 12 SPARGER PLENUM
- 13 SPARGER PLENUM
- 14 SPARGER PLENUM
- 15 SPARGER PLENUM
- 16 SPARGER PLENUM
- 17 SPARGER PLENUM
- 18 SPARGER PLENUM
- 19 SPARGER PLENUM
- 20 SPARGER PLENUM
- 21 SPARGER PLENUM
- 22 SPARGER PLENUM
- 23 SPARGER PLENUM
- 24 SPARGER PLENUM
- 25 SPARGER PLENUM
- 26 SPARGER PLENUM
- 27 SPARGER PLENUM
- 28 SPARGER PLENUM
- 29 SPARGER PLENUM
- 30 SPARGER PLENUM
- 31 SPARGER PLENUM
- 32 SPARGER PLENUM
- 33 SPARGER PLENUM
- 34 SPARGER PLENUM
- 35 SPARGER PLENUM
- 36 SPARGER PLENUM
- 37 SPARGER PLENUM
- 38 SPARGER PLENUM
- 39 SPARGER PLENUM

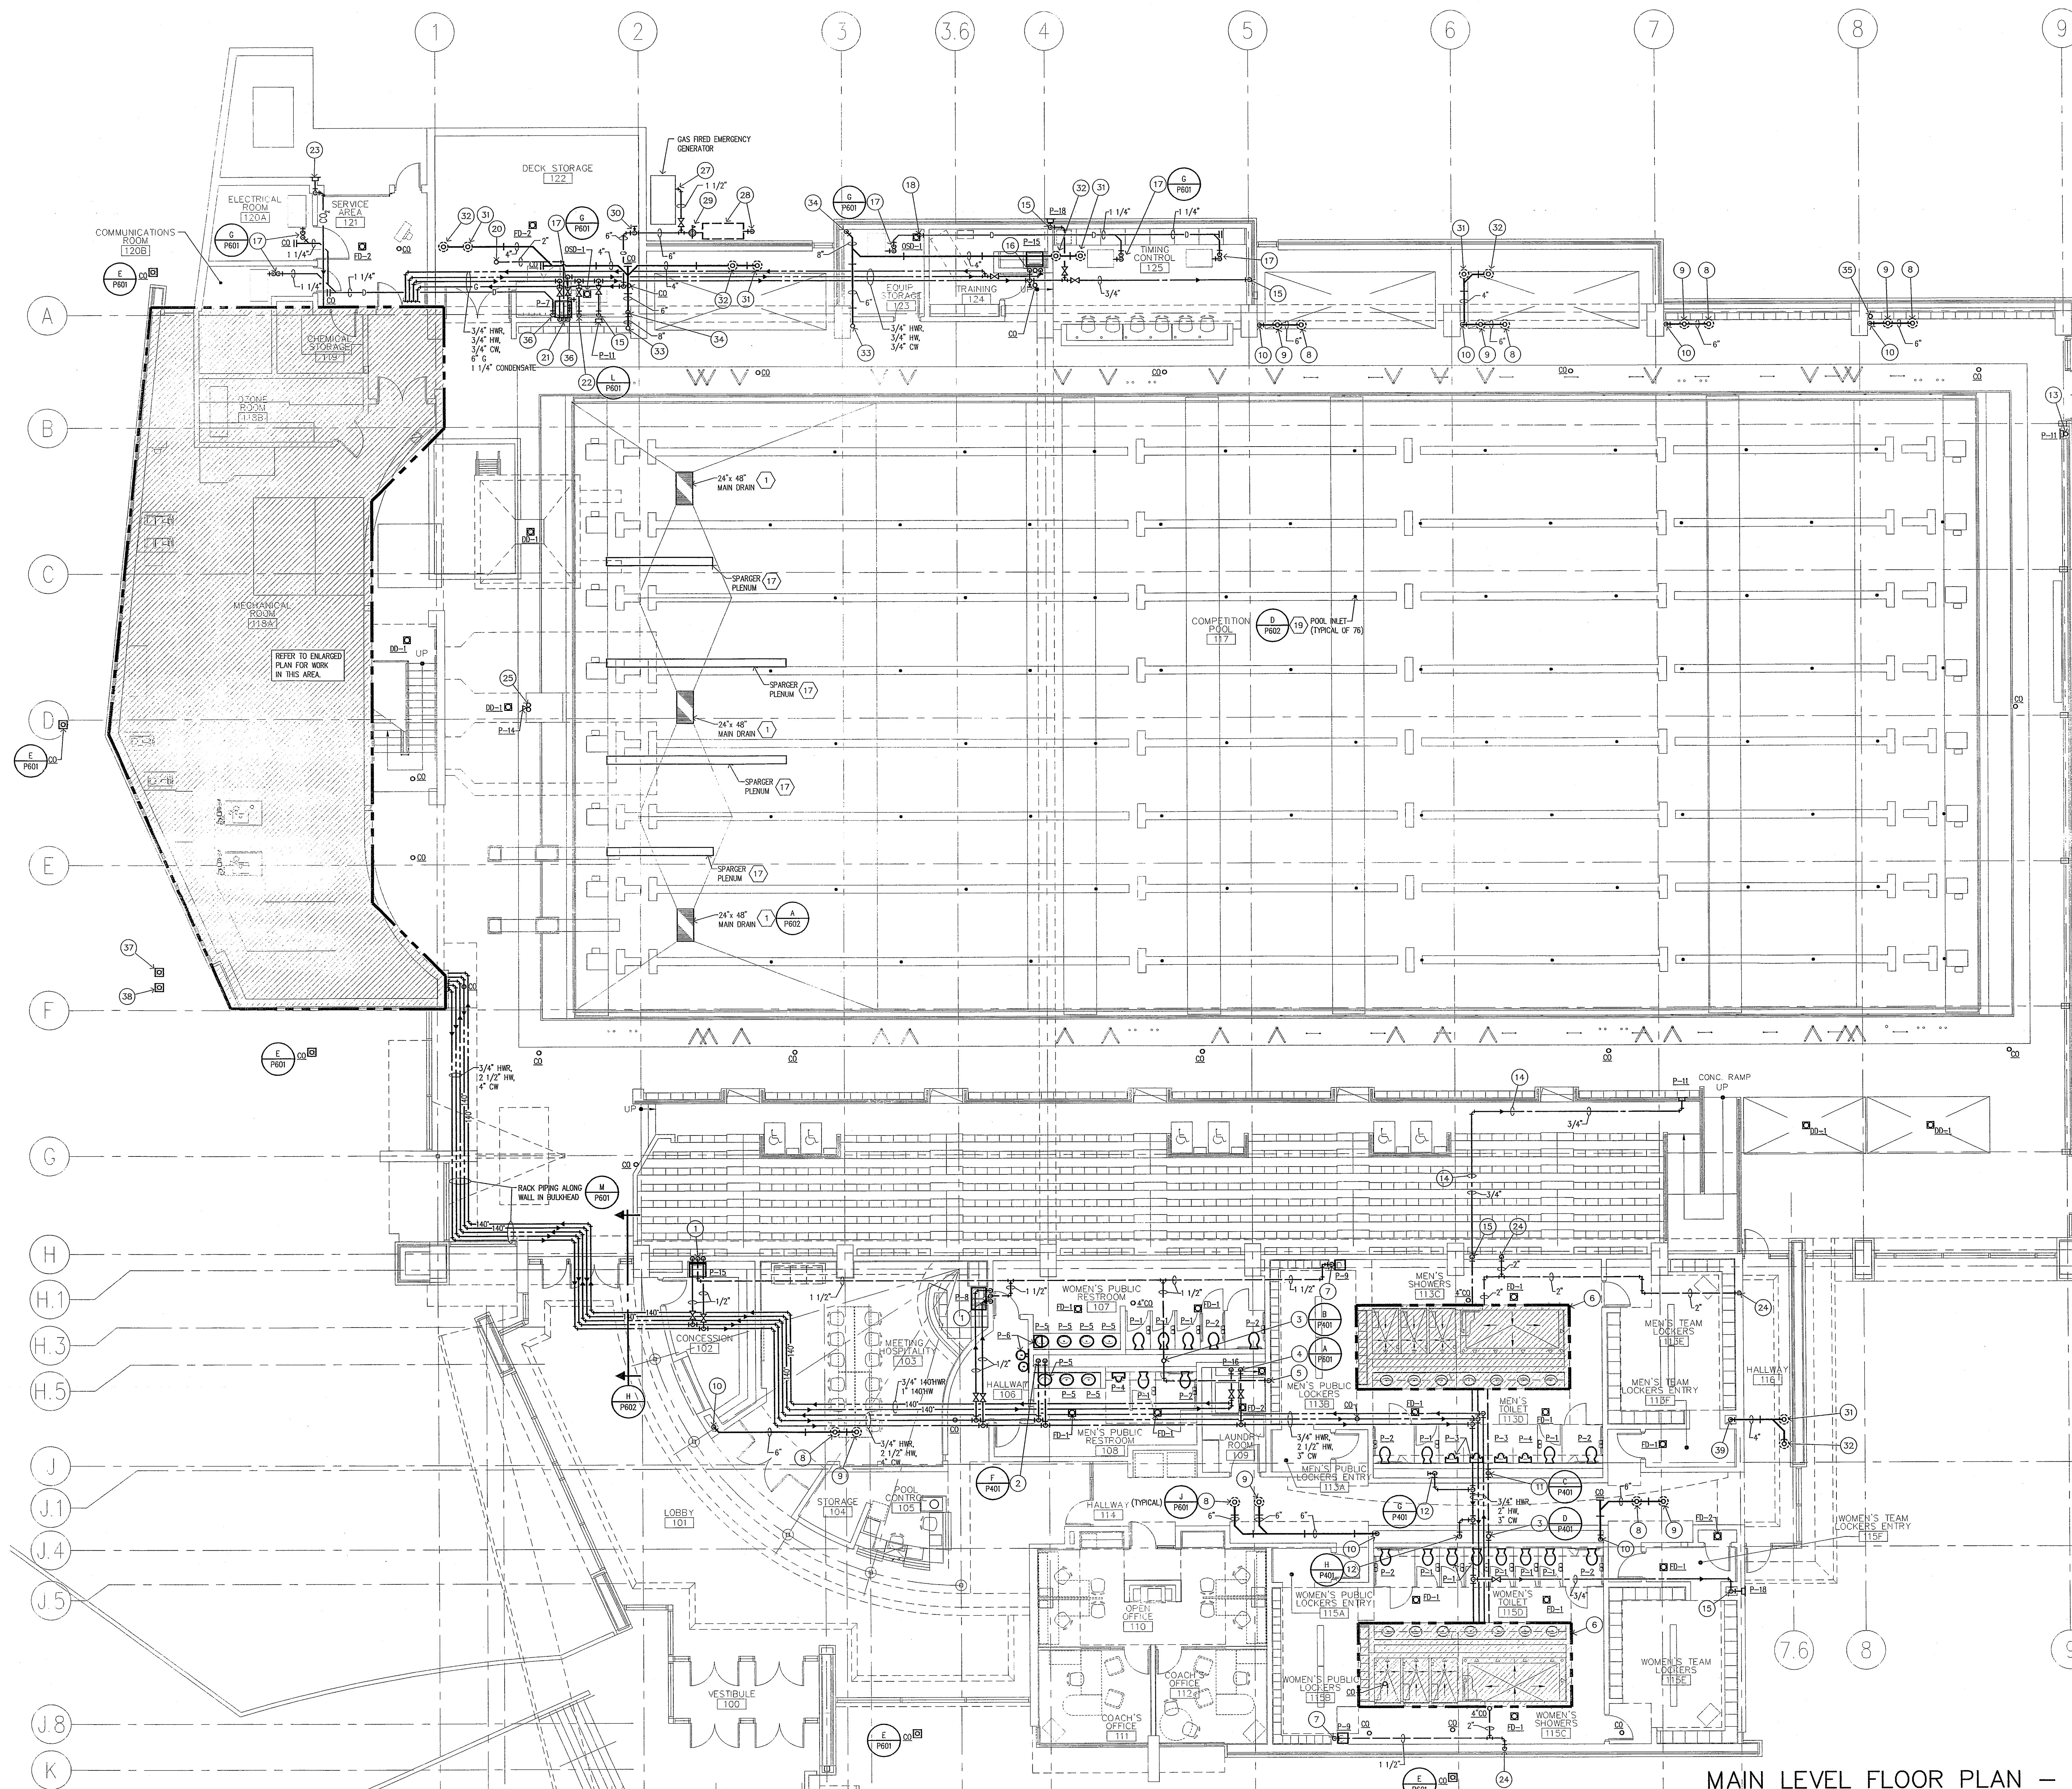

MAIN LEVEL FLOOR PLAN - PLUMBING

SCALE: 1/8" = 1'-0"



CONSTRUCTION DOCUMENTS

CARDINAL PARK NATATORIUM

UNIVERSITY OF LOUISVILLE

Project: 03006
 Drawn: TERRY GUNN
 Checked: GREG CHAMPION
 Scale: 1/8" = 1'-0"
 Issue Date: AUGUST 28, 2003
 Revision:

MAIN LEVEL FLOOR PLAN - PLUMBING

P202