


2 HVAC POWER DESIGN THIRD FLOOR
 PLAN - ALTERNATE
 1/8" = 1'-0"

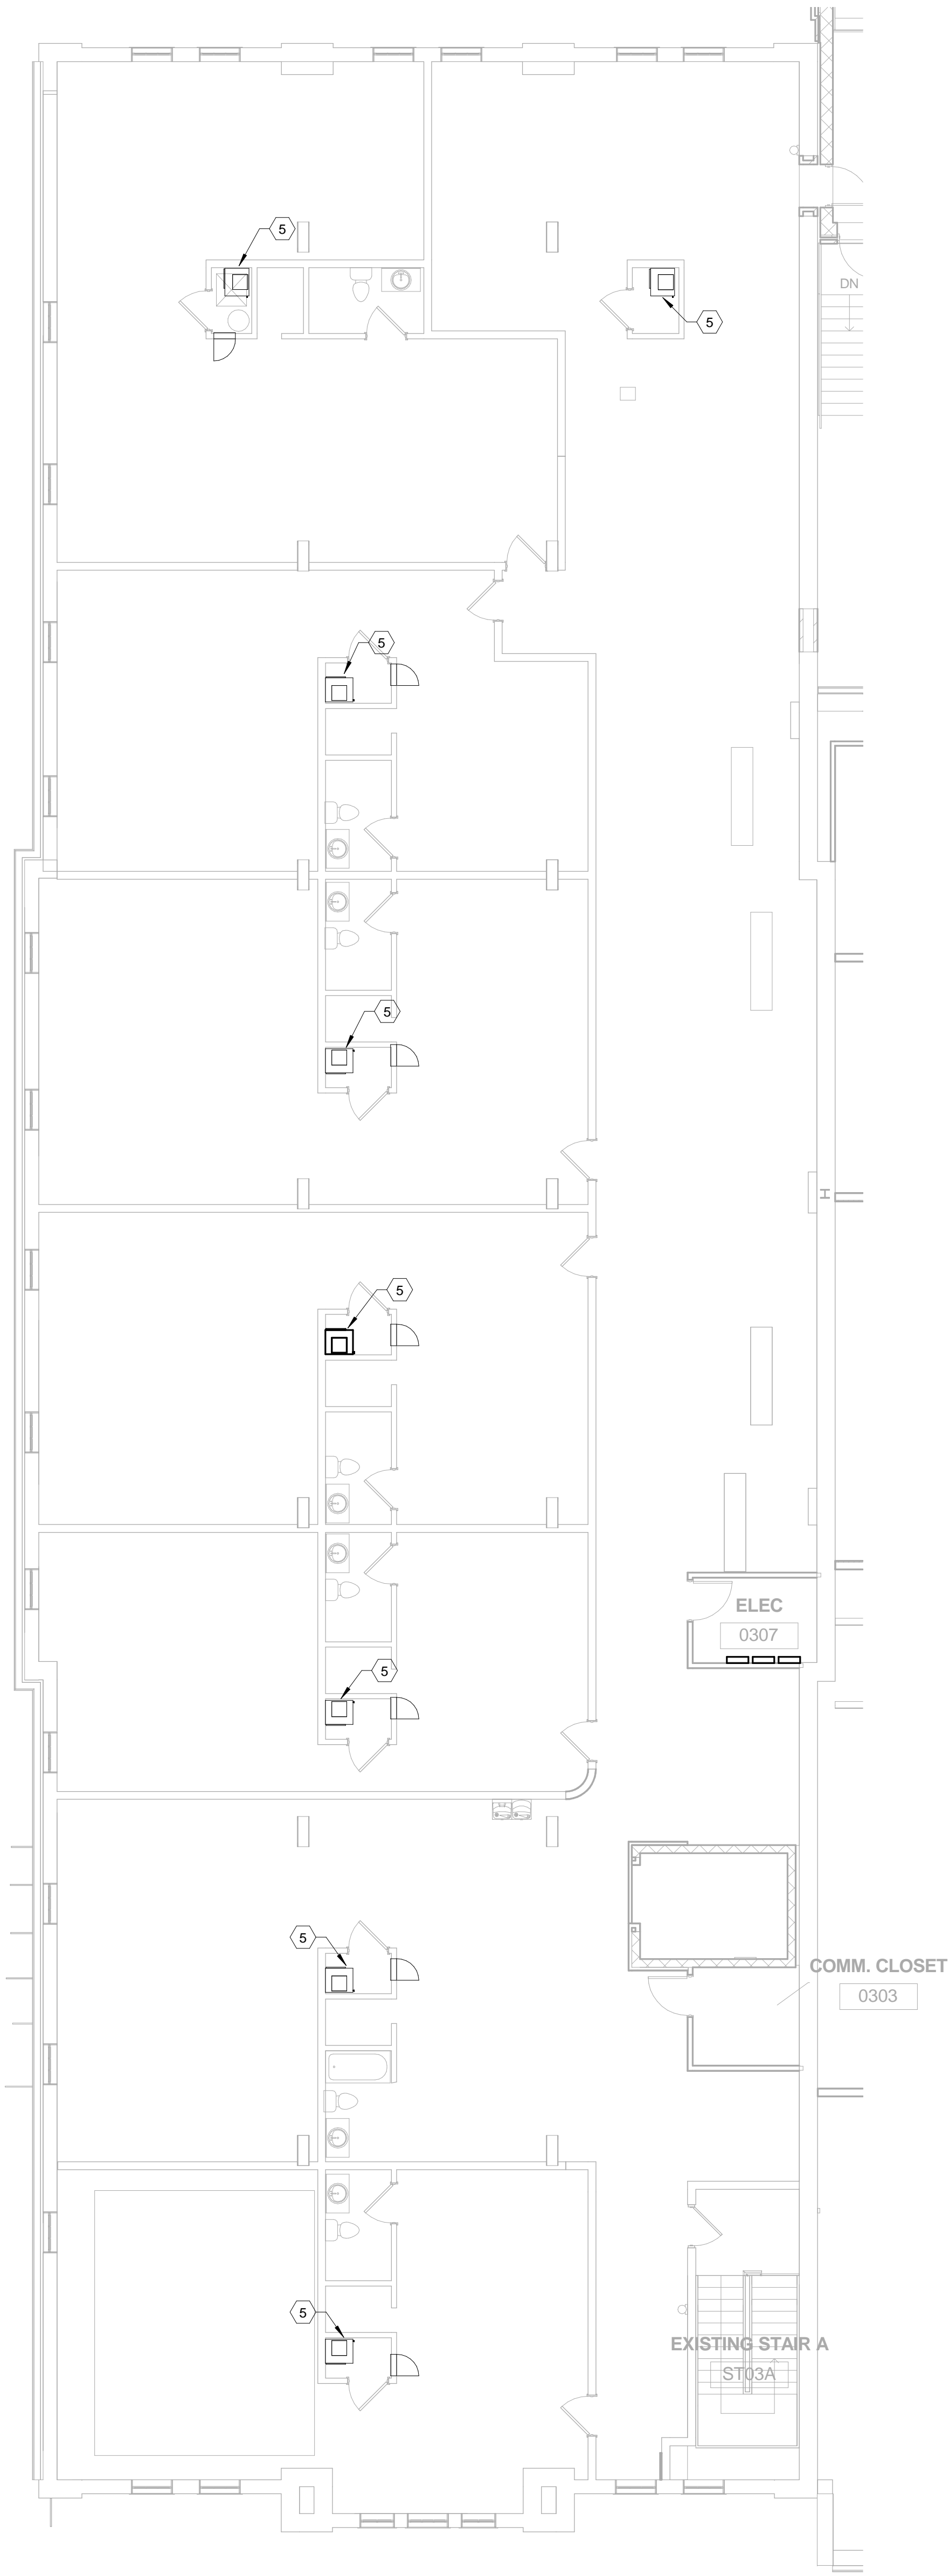

1 HVAC POWER DESIGN THIRD FLOOR
 PLAN - BASE BID
 1/8" = 1'-0"

HVAC POWER DESIGN THIRD FLOOR TAGGED NOTES (X)

- 1 PROVIDE A NEW NON-FUSED DISCONNECT RATED AT 30 AMPS, 208 VOLT, SINGLE PHASE, NEMA 1. REFERENCE MECHANICAL DETAILS FOR MOUNTING LOCATION. COORDINATE INSTALLATION WITH MECHANICAL CONTRACTOR.
- 2 DISCONNECT TO BE PROVIDED BY MECHANICAL CONTRACTOR. COORDINATE INSTALLATION WITH MECHANICAL CONTRACTOR.
- 3 INDOOR/OUTDOOR UNIT WITH SINGLE POINT ELECTRICAL CONNECTION. COORDINATE RACEWAY BETWEEN INDOOR AND OUTDOOR UNIT WITH MECHANICAL CONTRACTOR. ELECTRICAL CONTRACTOR IS RESPONSIBLE FOR ELECTRICAL PROVISIONS FOR BOTH UNITS.
- 4 CONNECT TRAP PRIMER TO CIRCUIT 3L2-33.
- 5 EXISTING INDOOR UNIT TO REMAIN. MAINTAIN EXISTING CIRCUIT TO LOCAL PANEL.