


① FIRE PROTECTION DEMO BASEMENT  
 PLAN  
 1/8" = 1'-0"

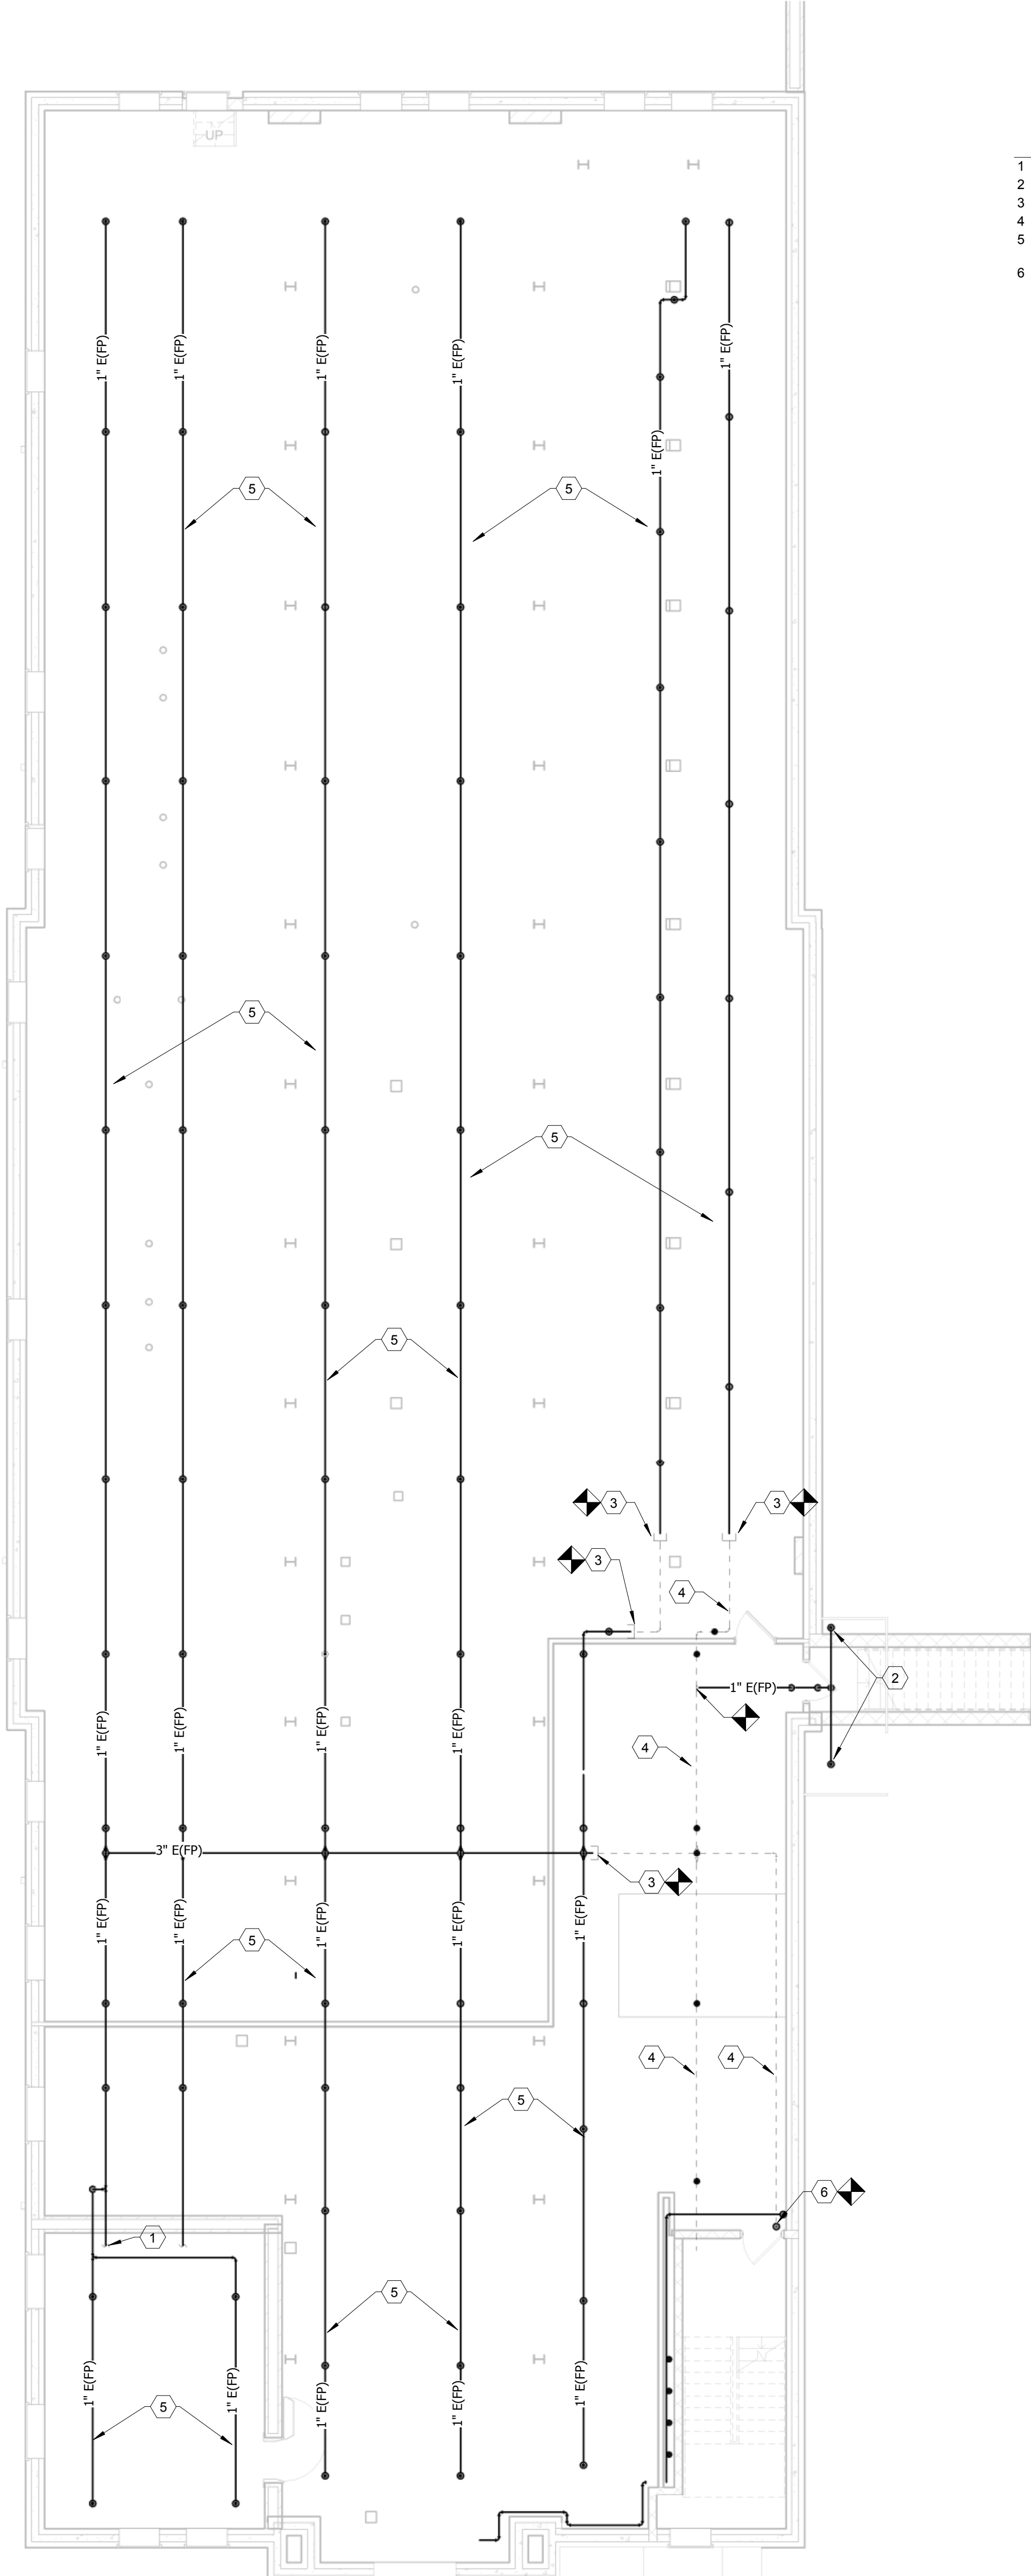

- FIRE PROTECTION DEMO BASEMENT PLAN TAGGED NOTES (X)
- 1 EXISTING FIRE PROTECTION PIPING ABANDONED ABOVE VAULT.
  - 2 FIRE PROTECTION PIPING AND SPRINKLER HEADS UNDER LANDING.
  - 3 CAP EXISTING FIRE PROTECTION LINE.
  - 4 REMOVE EXISTING FIRE PROTECTION PIPING.
  - 5 REMOVE ALL FIRE PROTECTION PIPING, VALVES AND SPRINKLER HEADS. REFER TO PLAN SHEET FP2.0 FOR NEW.
  - 6 3" FIRE PROTECTION STAND PIPE TO REMAIN. CAP FOR FUTURE CONNECTION.