


FIRE PROTECTION DESIGN BASEMENT  
 PLAN - ALTERNATE  
 1/8" = 1'-0"

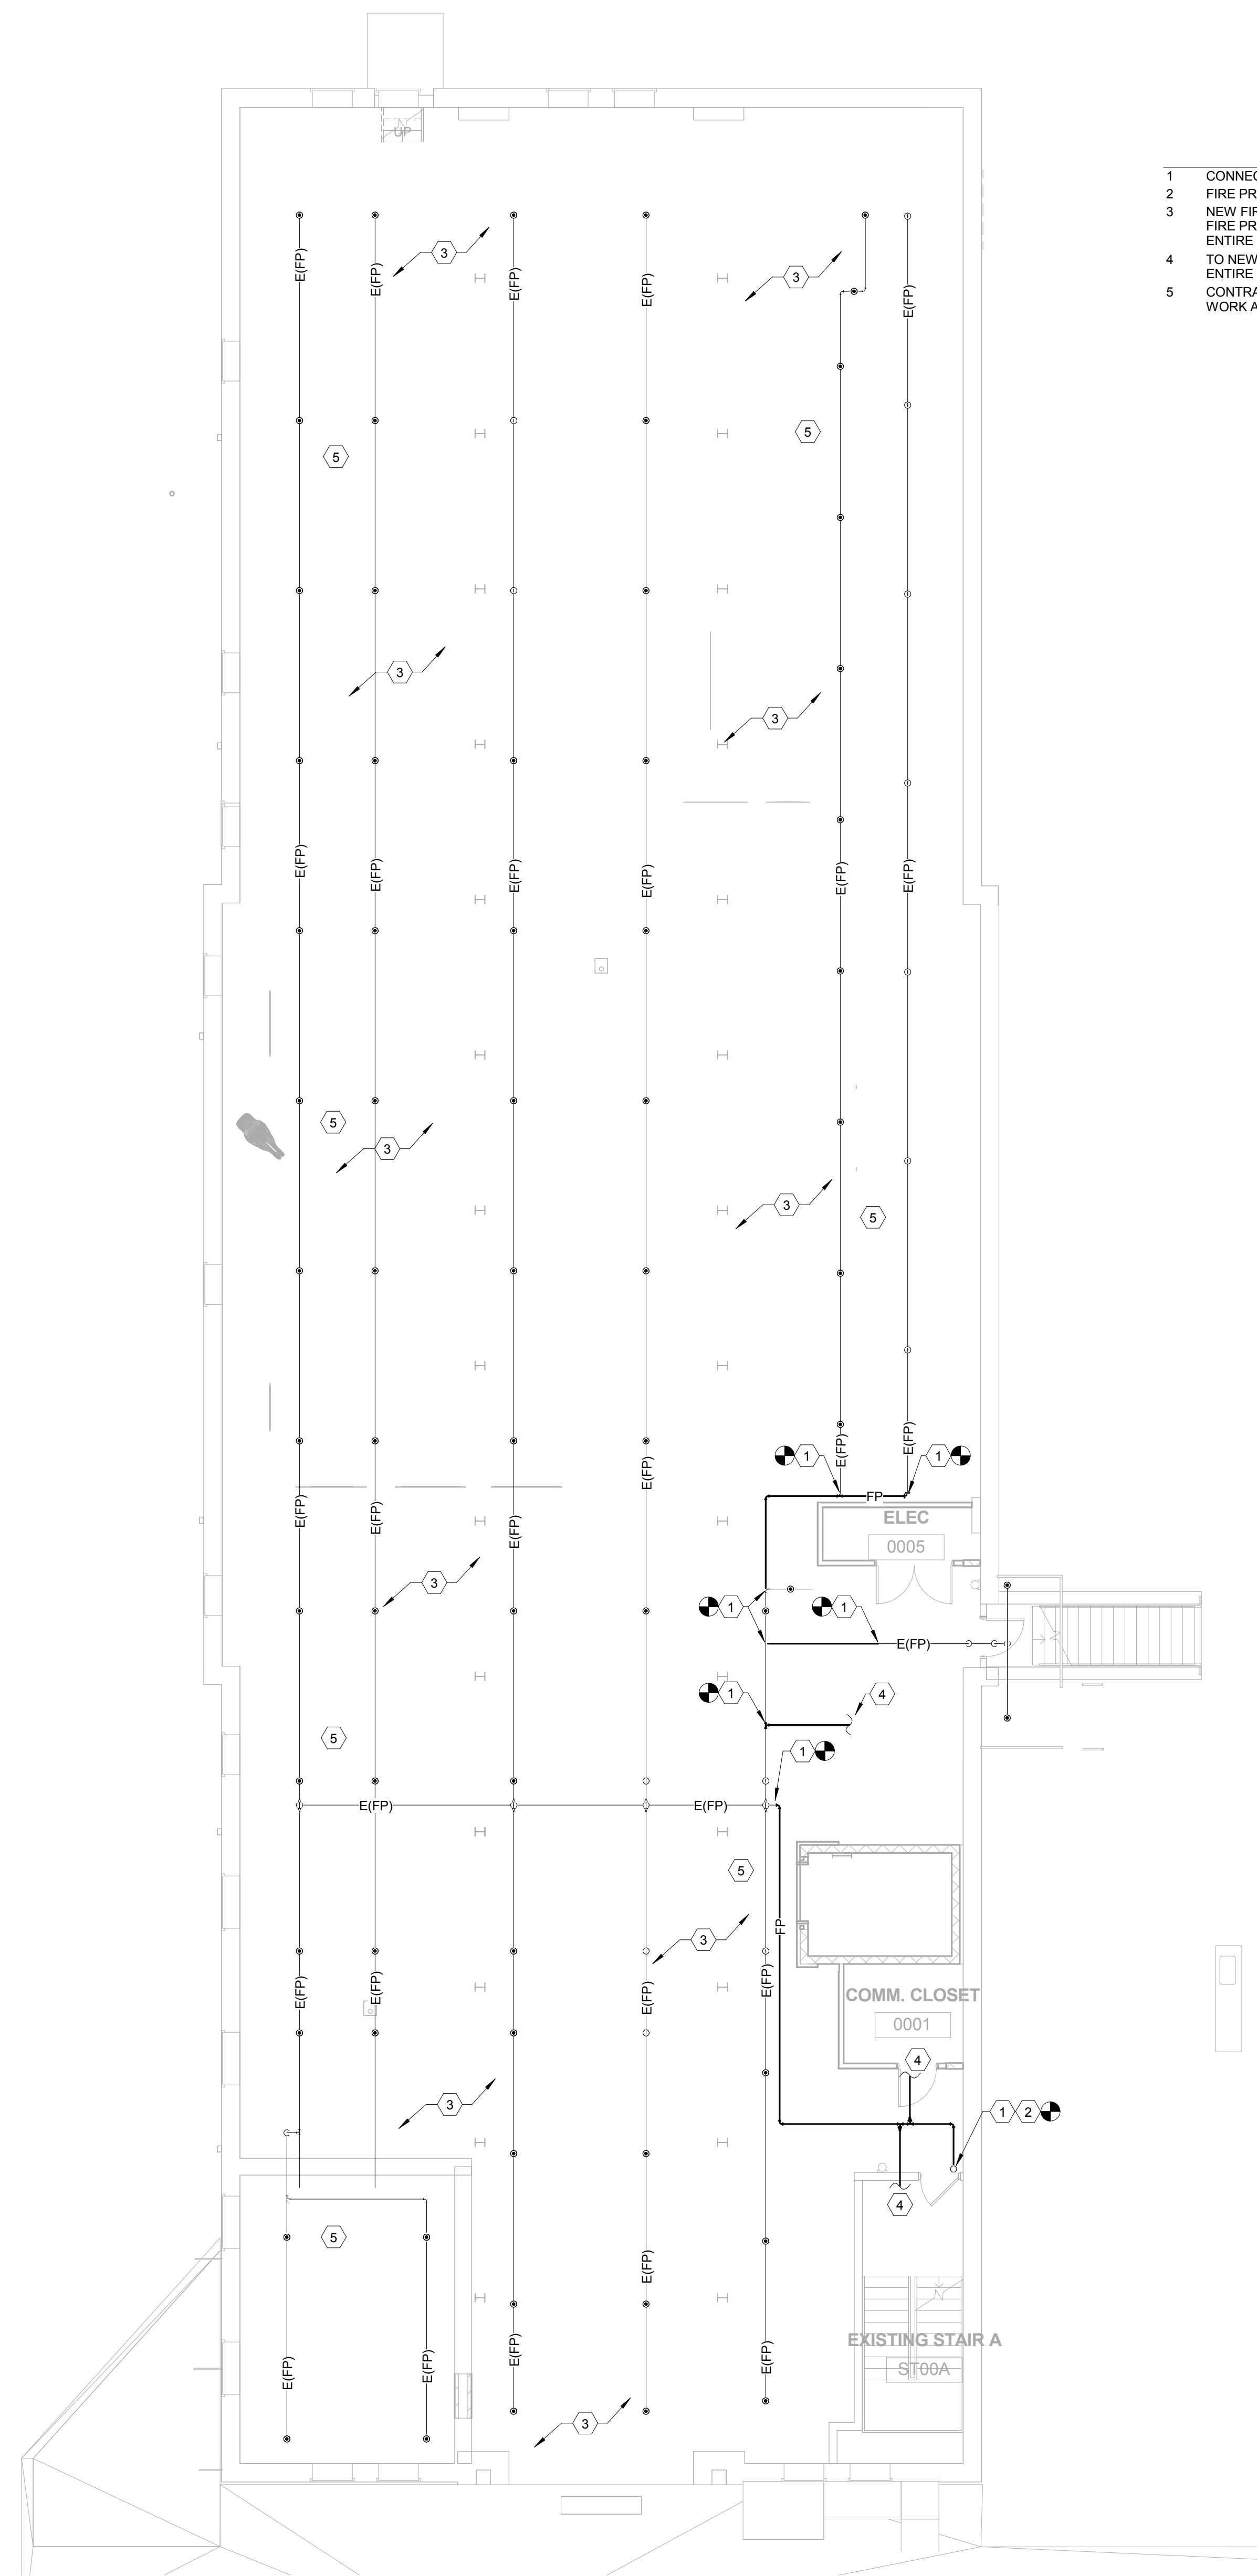

FIRE PROTECTION DESIGN BASEMENT  
 PLAN - BASE BID  
 1/8" = 1'-0"

- FIRE PROTECTION DESIGN BASEMENT PLAN TAGGED NOTES
- 1 CONNECT TO EXISTING FIRE PROTECTION PIPING.
  - 2 FIRE PROTECTION MAIN UP. REFER TO PLAN SHEET FP2.1 FOR CONTINUATION.
  - 3 NEW FIRE PROTECTION PIPING, VALVES AND SPRINKLER HEADS. CONTRACTOR SHALL ADD FIRE PROTECTION PIPING AND SPRINKLER HEADS TO PROVIDE 100% COVERAGE FOR THE ENTIRE BUILDING.
  - 4 TO NEW SPRINKLER HEADS. FIRE PROTECTION PIPE TO PROVIDE 100% COVERAGE FOR ENTIRE BUILDING.
  - 5 CONTRACTOR SHALL INSTALL NEW FIRE PROTECTION PIPING TO ACCOMMODATE NEW DUCT WORK AND CABLE TRAYS EVEN IF NOT INDICATED ON PLANS.