FIRE PROTECTION DESIGN THIRD FLOOR PLAN TAGGED NOTES

1 EXISTING FIRE PROTECTION LINES AND SPRINKLER HEADS SHALL REMAIN. CONTRACTOR SHALL ADD FIRE PROTECTION PIPING AND SPRINKLER HEADS TO PROVIDE 100% COVERAGE FOR THE ENTIRE BUILDING.

CONNECT TO FIRE PROTECTION MAIN. FIELD VERIFY EXACT LOCATION.

REROUTE EXISTING SPRINKLER PIPING TO ACCOMODATE NEW DUCTWORK AND

COMMUNICATIONS CABLE TRAYS. PROVIDE A MINIMUM OF 12" CLEAR ABOVE THE TRAY AND

FIRE PROTECTION MAIN DOWN. REFER TO SHEET FP2.2 FOR CONTINUATION.

5 CONTRACTOR SHALL REROUTE EXISTING SPRINKLER PIPING TO ACCOMONDATE NEW

TO NEW SPINKLER HEADS. FIRE PROTECTION PIPE TO PROVIDE 100% COVERAGE FOR THE ENTIRE BUILDING.


DUCTWORK AND CABLE TRAYS EVEN IF NOT INDICATED ON PLANS.

24" TO THE OPEN SIDE FOR ACCESS.



COMM. CLOSET 0303 ___

FIRE PROTECTION DESIGN THIRD
FLOOR PLAN - BASE BID
1/8" = 1'-0"

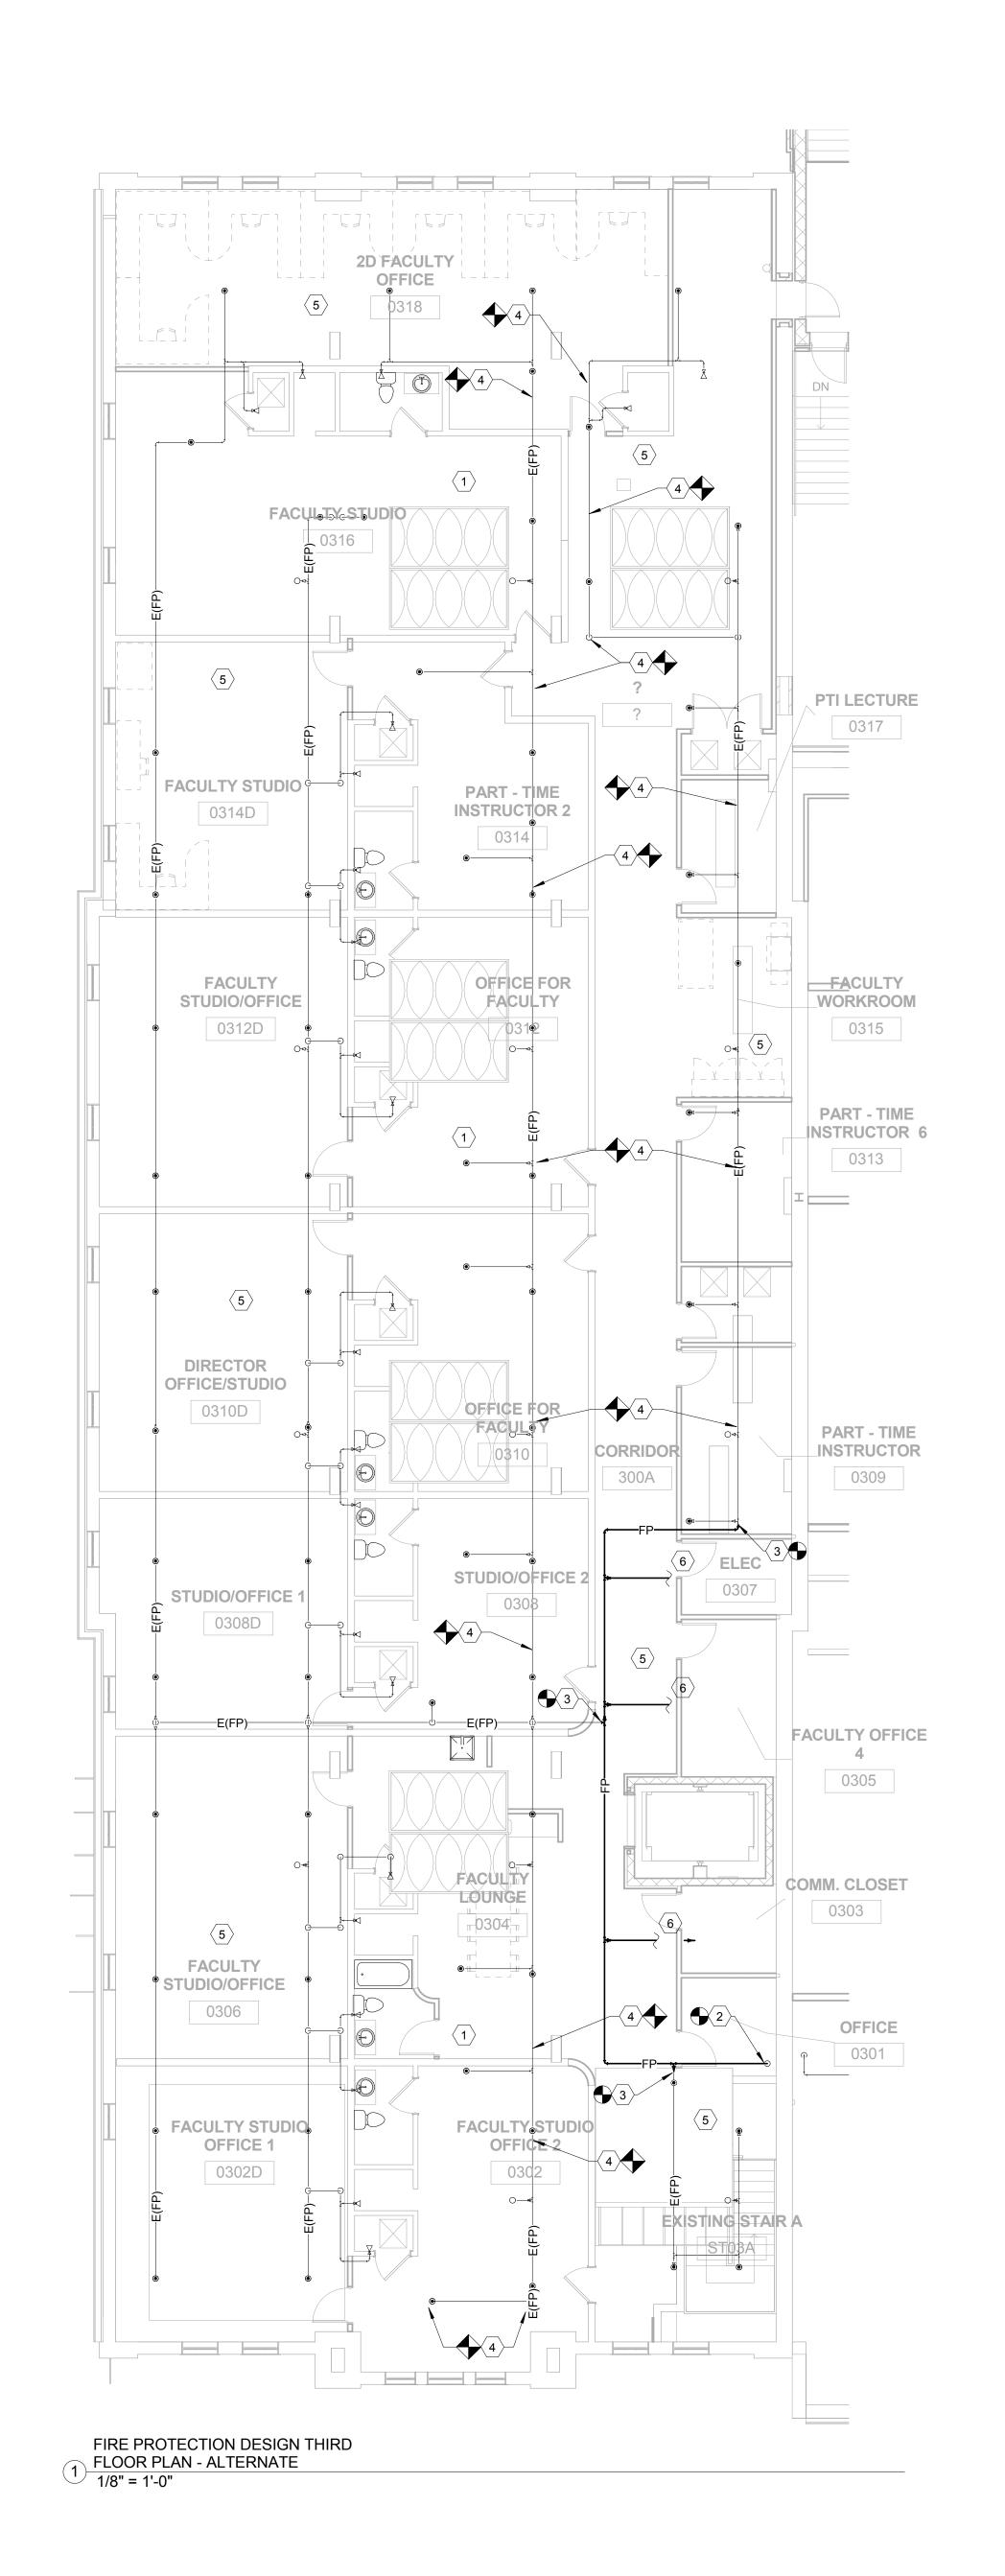

FP2.3