


HVAC PIPING BASEMENT PLAN -
 ALTERNATE
 ① 1/8" = 1'-0"

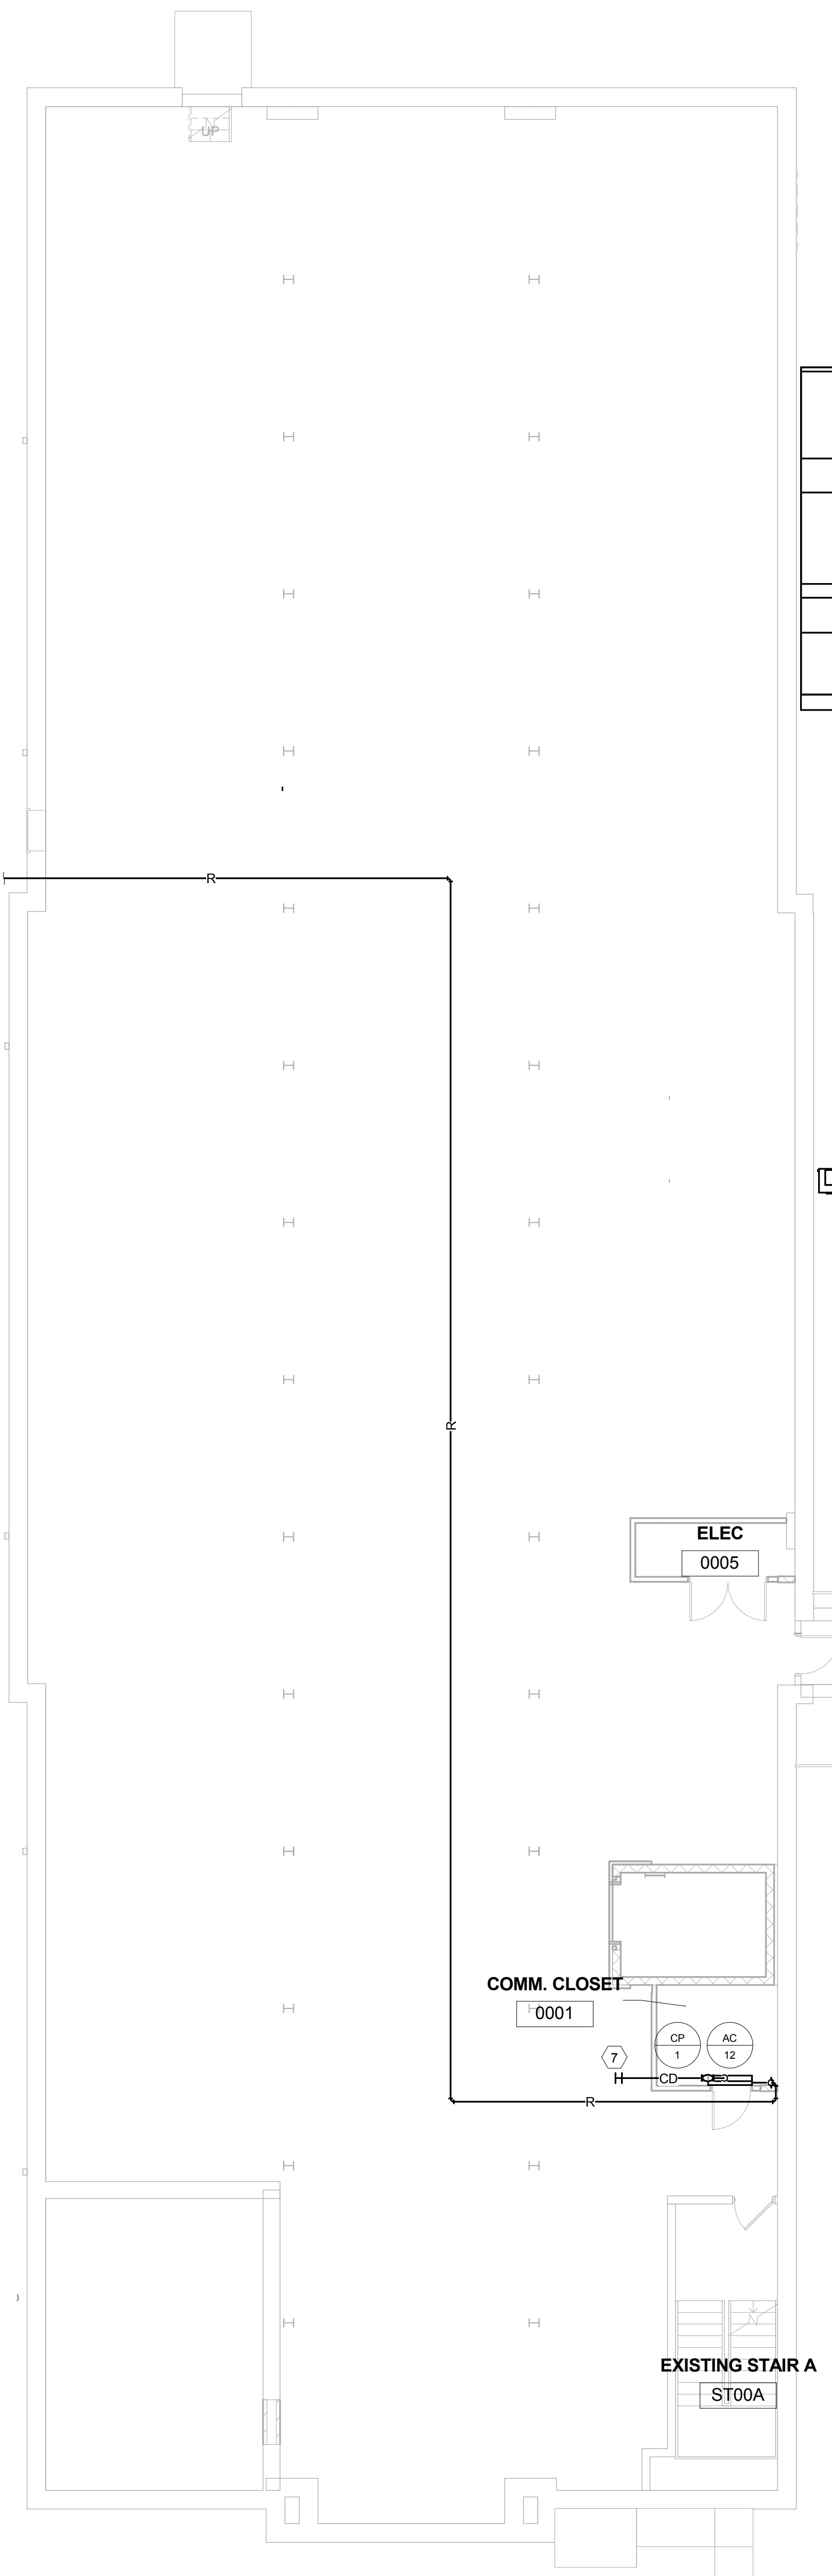

HVAC PIPING BASEMENT PLAN - BASE
 BID
 ② 1/8" = 1'-0"

HYDRONIC DESIGN BASEMENT PLAN TAGGED NOTES

- 1 RELOCATED EXISTING INDOOR UNIT. PROVIDE NEW REFRIGERANT PIPING FROM INDOOR UNIT TO CONDENSING UNIT. TYPICAL.
- 2 ROUTE REFRIGERANT PIPING THRU EXTERIOR WALL. SIZE PER MANUFACTURERS RECOMMENDATION. REFER TO HVAC PIPING DESIGN FIRST FLOOR PLAN FOR CONTINUATION.
- 3 SPILL CONDENSATE TO FLOOR DRAIN. TYPICAL.
- 4 PROVIDE ALL NEW REFRIGERANT PIPING TRAPS, AND ACCESSORIES IN ACCORDANCE WITH GOOD INDUSTRY PRACTICE FOR ALL RELOCATED SPLIT SYSTEMS. UNIT SHALL BE RETURNED TO FULL WORKING CONDITION. TYPICAL OF ALL RELOCATED SPLIT SYSTEMS WHETHER SPECIFICALLY INDICATED OR NOT.
- 5 2" HOT WATER PIPE UP.
- 6 CAP 2" HOT WATER PIPES FOR FUTURE EXTENSION.
- 7 SPILL CONDENSATE TO NEAREST FLOOR DRAIN.