


HVAC PIPING THIRD FLOOR PLAN - ALTERNATE
 2 1/8" = 1'-0"

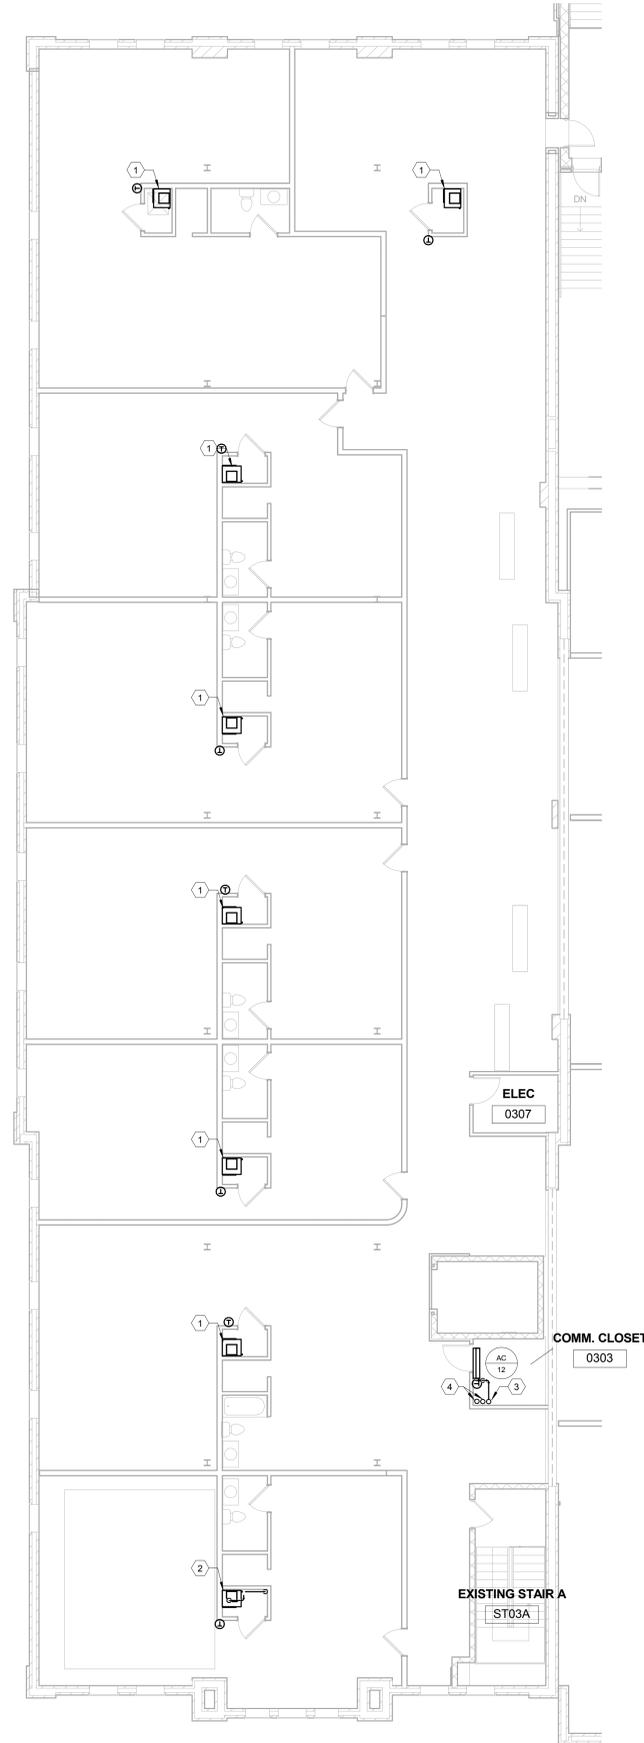

HVAC PIPING THIRD FLOOR PLAN - BASE BID
 1 1/8" = 1'-0"

HYDRONIC DESIGN THIRD FLOOR PLAN TAGGED NOTES

- 1 EXISTING INDOOR UNIT TO REMAIN. TYPICAL
- 2 RELOCATED EXISTING INDOOR UNIT. PROVIDE NEW REFRIGERANT PIPING FROM INDOOR UNIT TO CONDENSING UNIT.
- 3 ROUTE REFRIGERANT PIPING UP. REFER TO MECHANICAL DESIGN ROOF PLAN FOR CONTINUATION.
- 4 ROUTE REFRIGERANT PIPING UP AND DOWN. REFER TO HYDRONIC DESIGN SECOND FLOOR AND MECHANICAL DESIGN ROOF PLAN FOR CONTINUATION.
- 5 PROVIDE ALL NEW REFRIGERANT PIPING TRAPS AND ACCESSORIES IN ACCORDANCE WITH GOOD INDUSTRY PRACTICE FOR ALL RELOCATED SPLIT SYSTEMS. UNIT SHALL BE RETURNED TO FULL WORKING CONDITION. TYPICAL OF ALL RELOCATED SPLIT SYSTEMS WHETHER SPECIFICALLY INDICATED OR NOT.
- 6 2" HOT WATER SUPPLY AND RETURN DOWN TO SECOND FLOOR.
- 7 CAP PIPE FOR FUTURE EXTENSION.
- 8 ROUTE 3/4" CONDENSATE DRAIN TO FLOOR DRAIN.
- 9 ROUTE 1" CONDENSATE DRAIN DOWN TO SECOND FLOOR. REFER TO HVAC PIPING DESIGN SECOND FLOOR PLAN FOR CONTINUATION.